

Zeno-Protect B.V.
t.a.v. de heer Pieter de Jong Jr
PO Box 101
1520 AC Wormermeer
Netherlands

contact
Didier Van Daele

e-mail
didier.vandaele@UGent.be

Date
11/01/11

TEST REPORT 10-964 A

Samples received :

Excellence
Received on 23/11/2010

Aim of the test :

Determination of Vetterman

Test conditions :

Change of appearance Vetterman Drum

Standard: ISO 10361 (2000)* - method A assessment according to EN 1471 – 1996 and ISO 9405
Method: A metal ball with 14 rubber caps rolls freely in a tumbling drum covered with carpet test samples, of which the user surface is orientated to the inner side. The change of appearance is assessed by 3 persons: assessment 5 means no change, assessment 1 means very severe change.
Number of tests: 2 (1 sample at 5000 cycles and 1 sample at 22000 cycles)
Measurement uncertainty: The international criterion for measurement uncertainty is a half point.
Test conditions: 20 ± 2°C and 65 ± 4% relative humidity

The tests were performed in week 48/2010

The test results only apply to materials that correspond to the tested sample. Forgery will be legally prosecuted, just like partial reproduction without prior written permission. Tests that are marked *are accredited, those marked ° are not accredited. Advices and interpretations are not covered by the accreditation.

The department of Textiles is Notified laboratory n°1611 for the European Products directive 89/106/EC.

OBTAINED RESULTS

Change of appearance Vetterman Drum


- 1

Assessor	change after 5000 rotations		
	colour	structure	corrected structure
1	3-4	4.0	-
2	3-4	4.0	-
3	3-4	4.0	-
average	3-4	4.0	-


Assessor	change after 22000 rotations		
	colour	structure	corrected structure
1	3	3.5	-
2	3	3.5	-
3	3	3.5	-
average	3	3.5	-

Remark: when assessment of colour equals 2 or is lower than 2, structure is upgraded with 0.5 value.

Classification: class 33

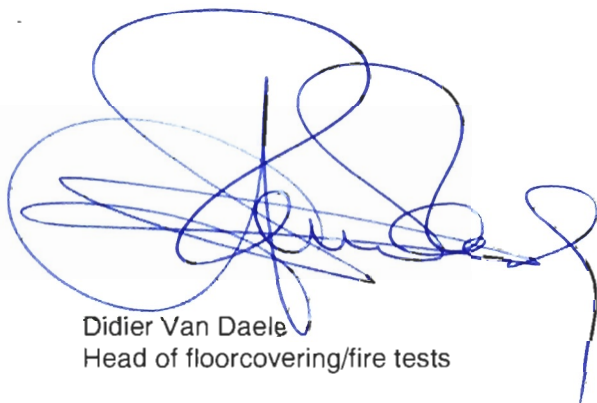

Didier Van Daele
Head of floorcovering/fire tests

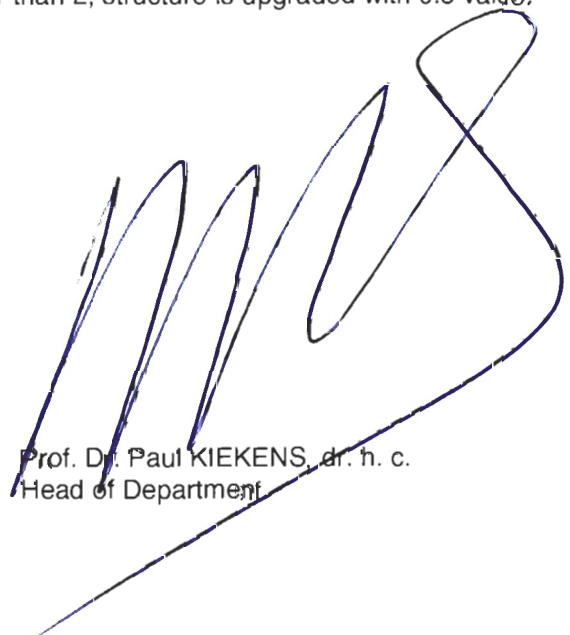

Prof. Dr. Paul KIEKENS, dr. h. c.
Head of Department